

SAFETY ORGANIZATION(S):

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET.

UL RECOGNIZED
CSA CERTIFIED
VDE APPROVED
SEV APPROVED

UL 1283
CSA 22.2, NO.0,0.4,8
VDE 565-3
SEV 1055/TP1977/5.1.1

OPERATING SPECIFICATIONS:

LINE VOLTAGE/CURRENT: 10 AMP, 120/250 VAC
8 AMP./40°C, 250 VAC

LINE FREQUENCY: 50-60Hz

MAX. CASE RISE @ RATED CURRENT: 40°C

MAX. LEAKAGE CURRENT, EACH: .25 mA AT 120V 60Hz

LINE TO GROUND: .4 mA at 250V 50Hz

OPERATING AMBIENT TEMP. RANGE: -10°C TO +40°C @ RATED CURRENT, I_r

IN AN AMBIENT, T_a , HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT, I_o , IS AS FOLLOWS:

$$I_o = I_r \sqrt{\frac{85 - T_a}{45}}$$

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE: -40°C TO +85°C

HUMIDITY: 21 DAYS @ 40°C 95% RH

CURRENT OVERLOAD TEST: 6 TIMES RATED CURRENT FOR 8 SECONDS

TEST SPECIFICATIONS:

INDUCTANCE: 14.26 mH NOMINAL

CAPACITANCE, MEASURED @ 1 KHz, 0.25VAC MAX., 25°C±1°C

LINE TO GROUND: .0056µF ±20%

LINE TO LINE: .811µF ±20%

DISCHARGE RESISTOR: 330KΩ

LINE/GROUND AND LINE/LINE INSULATION RESISTANCE:
6000MΩ (MIN) AT 100VDC, 20°C AND 50% RH.

RECOMMENDED RECEIVING INSPECTION HIPOT:

LINES TO GROUND: 2250 VDC FOR 1 MINUTE

LINE TO LINE: 1450 VDC FOR 1 MINUTE

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

.250 X .187 SLOT
EITHER OR BOTH ENDS
AND/OR



0.187±.010 DIA
(2)

GRN/YEL


BLUE

BROWN


4.0 MIN
(5 PLCS)

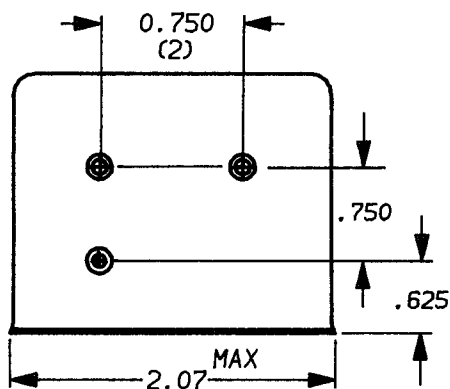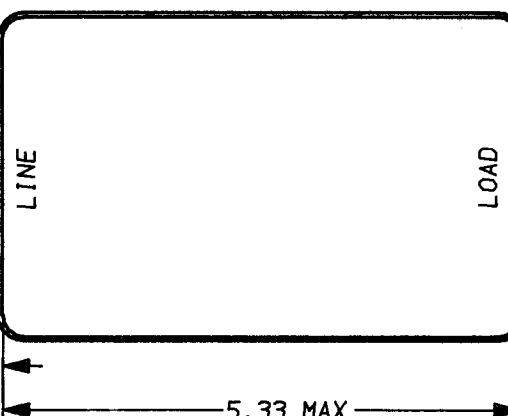

0.25 STRIP
(5 PLCS)

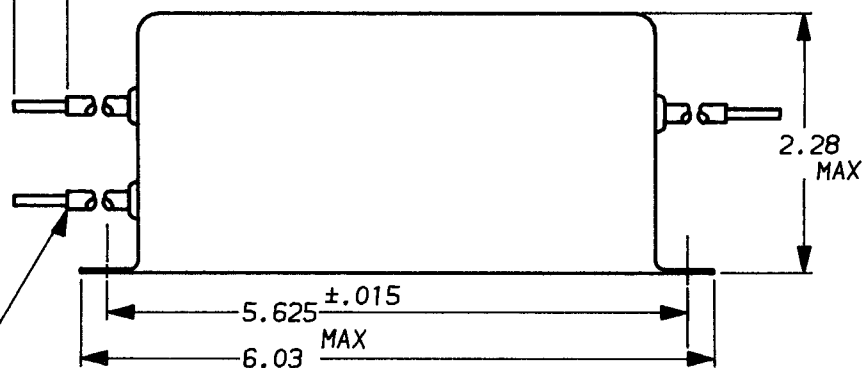

#14 AWG WIRE (5 LEADS)

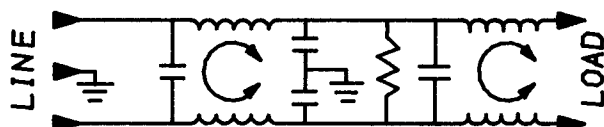50Ω - 50Ω (MINIMUM) INSERTION LOSS

FREQUENCY MHz	.01	.04	.05	.06	.15	.5	5.0	10	20	30	/	/
COMMON dB	1	1	10	18	58	65	65	60	38	25	/	/
DIFF. dB	1	2	3	3	30	65	65	65	35	35	/	/

UNLESS OTHERWISE SPECIFIED,
TOLERANCE TO BE ±.025
MATERIAL & FINISH, AS SUPPLIED

This document is proprietary to CORCOM INC.
and is not to be reproduced nor used for
manufacturing purposes except on CORCOM'S
prior written consent.

corcom
LIBERTYVILLE, IL 60048

POWER LINE FILTER

DATE: 12-13-94

CATALOG NO.

APPROV. *me*

10EP3.06

ECN #11131

CAD NO.

10EP3.06