

C. West	8-27-90	1
DESCRIPTION	APP'D./DATE	REV

SAFETY ORGANIZATION(S):

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET.


- UL RECOGNIZED
CSA CERTIFIED
OPERATING SPECIFICATIONS:
LINE VOLTAGE/CURRENT:
20 OR 30 AMP, 250VAC PHASE TO NEUTRAL/GND
20 OR 30 AMP, 440VAC PHASE TO PHASE
50-60Hz
1.4 ma @ 120 V 50 Hz
3.4 ma @ 250 V 50 Hz
-10°C TO +40°C @ RATED CURRENT, I_r
- LINE FREQUENCY:
MAX. LEAKAGE CURRENT, EACH
LINE TO GROUND
OPERATING AMBIENT TEMP. RANGE:
IN AN AMBIENT, I_o, HIGHER THAN 40°C, THE MAXIMUM OPERATING
CURRENT, I_o, IS AS FOLLOWS:
 $I_o = I_r \sqrt{\frac{85 - T_o}{45}}$
-25°C TO +85°C
21 DAYS @ 40°C 95% RH
- RELIABILITY SPECIFICATIONS:
STORAGE TEMPERATURE:
HUMIDITY:

- TEST SPECIFICATIONS:
INDUCTANCE: 20A = 4.4mH NOMINAL 30A = 1.97 mH NOMINAL
CAPACITANCE: (MEASURED @ 1 KHz, 0.25 VAC MAX., 25°C ±1°C)
PHASE/NEUTRAL TO GROUND: .018uF ±20%
PHASE TO NEUTRAL: 3.29uF ±20%
DISCHARGE RESISTOR: 110 KΩ
PHASE/NEUTRAL TO GROUND AND
PHASE TO PHASE INSULATION
RESISTANCE: 5000 MΩ (MIN) AT 100 VDC
(W/O DISCHARGE RESISTOR)
20°C AND 50% RH


RECOMMENDED RECEIVING INSPECTION HIPOIT.

- PHASE TO GROUND 1500 VAC FOR 1 MINUTE
- NEUTRAL TO GROUND 1500 VAC FOR 1 MINUTE
- PHASE TO NEUTRAL 1450 VDC FOR 1 MINUTE
- FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

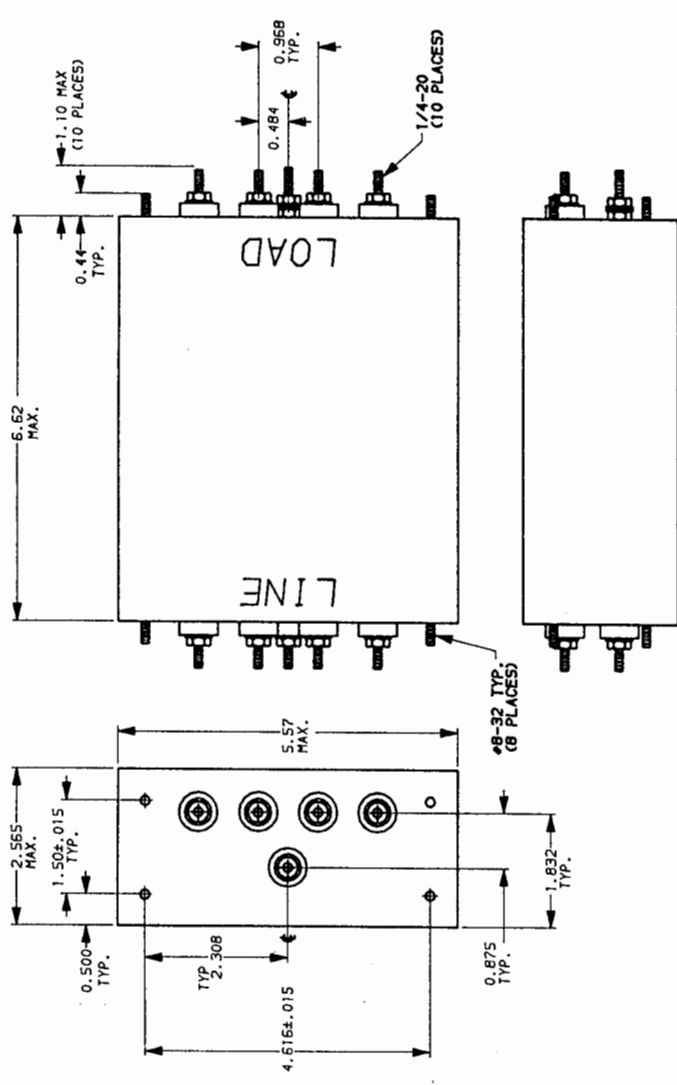

NOTE: UNLESS OTHERWISE SPECIFIED, TOLERANCE TO BE ±.045

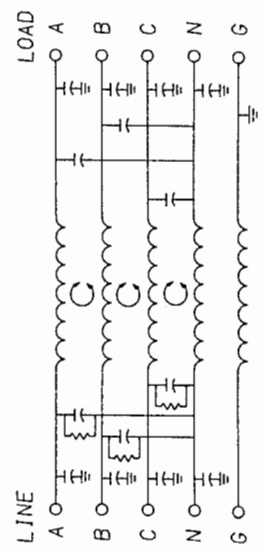

50n - 50n (MINIMUM) INSERTION LOSS									
FREQUENCY MHz	.05	.15	.50	1.0	5.0	10	30	50	100
COMMON	20A	22	39	55	56	65	65	65	54
dB	30A	15	30	55	55	61	63	50	
DIFF.	20A	20	50	65	65	65	65	52	
dB	30A	5	14	65	65	65	59	48	

This document is proprietary to CORCOM INC. and is not to be reproduced nor used for manufacturing purposes except on CORCOM's order or prior written consent.

TOLERANCE EXCEPT AS NOTED
DECIMAL: .XXX .XX .X ANGLES
ENGLISH: — ± 1°
METRIC: ± —

MATERIAL: AS SUPPLIED

FINISH:

corcom
LIBERTYVILLE, IL 60048

POWER LINE FILTER

SCALE	DATE	DRG. NO.	REV.
1:2	5-9-88		
BY	ORIGINATOR		
TDL	CW	20AYP6C & 30AYP6C	01