

10ER3

SAFETY ORGANIZATION(S):

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET.

UL RECOGNIZED  
CSA CERTIFIED  
VDE APPROVED  
SEV APPROVED

UL 1283  
CSA 22.2, NO.0,0.4,8  
VDE 565-3  
SEV 1055/TP1977/5.1.1

OPERATING SPECIFICATIONS:

LINE VOLTAGE/CURRENT, 10 AMP, 120/250 VAC  
8 AMP./40°C, 250 VAC  
LINE FREQUENCY, 50-60Hz

MAX. LEAKAGE CURRENT, EACH, .25 mA AT 120V 60Hz  
LINE TO GROUND, .40 mA at 250V 50Hz

OPERATING AMBIENT TEMP. RANGE, -10°C TO +40°C @ RATED CURRENT,  $I_r$

IN AN AMBIENT,  $T_a$ , HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT,  $I_o$ , IS AS FOLLOWS:

$$I_o = I_r \sqrt{\frac{85 - T_a}{45}}$$

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE, -40°C TO +85°C  
HUMIDITY, 21 DAYS @ 40°C 95% RH  
CURRENT OVERLOAD TEST, 6 TIMES RATED CURRENT FOR 8 SECONDS

TEST SPECIFICATIONS:

INDUCTANCE, .99 mH NOMINAL  
CAPACITANCE, (MEASURED @ 1 KHz, 0.25VAC MAX., 25°C±1°C)  
LINE TO GROUND, .006  $\mu$ F ±20%  
LINE TO LINE, .301  $\mu$ F ±20%  
DISCHARGE RESISTOR, 680K $\Omega$

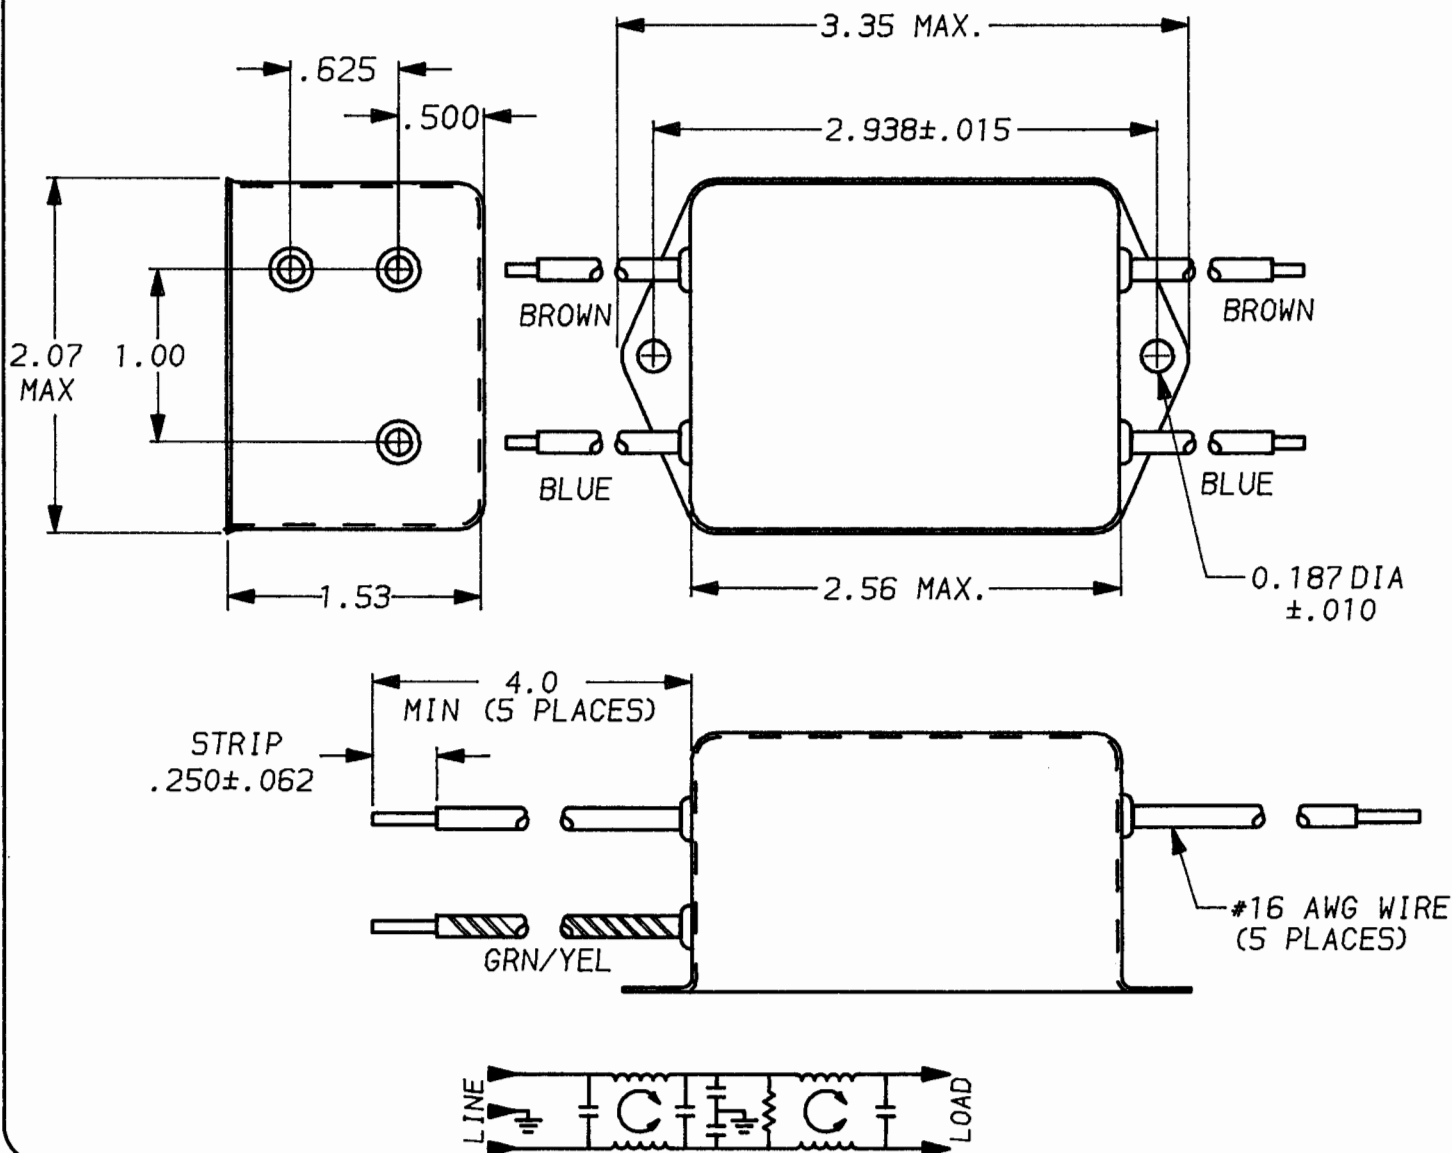
LINE/GROUND AND LINE/LINE, 6000M $\Omega$  (MIN) AT 100VDC  
INSULATION RESISTANCE, 20°C AND 50% RH

RECOMMENDED RECEIVING INSPECTION HIPOT:

LINES TO GROUND, 2250 VDC FOR 1 MINUTE  
LINE TO LINE, 1450 VDC FOR 1 MINUTE

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

50 $\Omega$  - 50 $\Omega$  (MINIMUM) INSERTION LOSS

FREQUENCY MHz	.15	.5	.6	1	2	.5	10	20	30	/	/	/
COMMON dB	5	46	48	56	65	65	65	65	65	/	/	/
DIFF. dB	3	3	3	35	65	65	65	60	54	/	/	/

UNLESS OTHERWISE SPECIFIED,  
TOLERANCE TO BE ±.025

MATERIAL & FINISH, AS SUPPLIED

This document is proprietary to CORCOM INC.  
and is not to be reproduced nor used for  
manufacturing purposes except on CORCOM'S  
prior written consent.

**corcom**  
LIBERTYVILLE, IL 60048

POWER LINE FILTER

DATE: 9-24-93 CATALOG NO.

APPRD. *TAM* 10ER3

CAD NO. 10ERS.04