

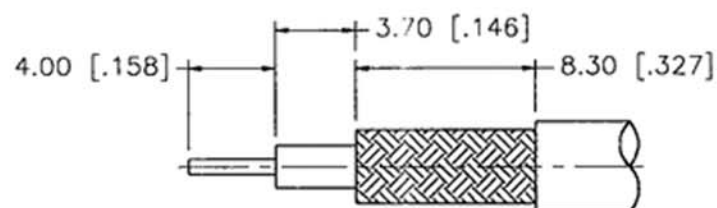
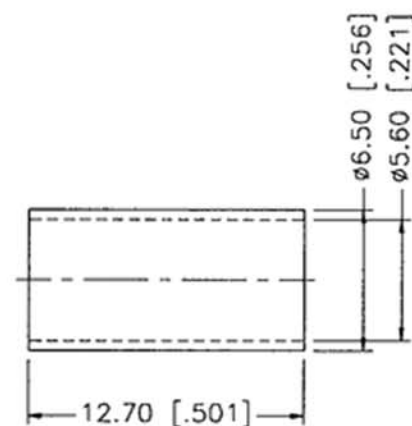


REV.	DATE	DESCRIPTION
NC	12/19/99	INITIAL RELEASE

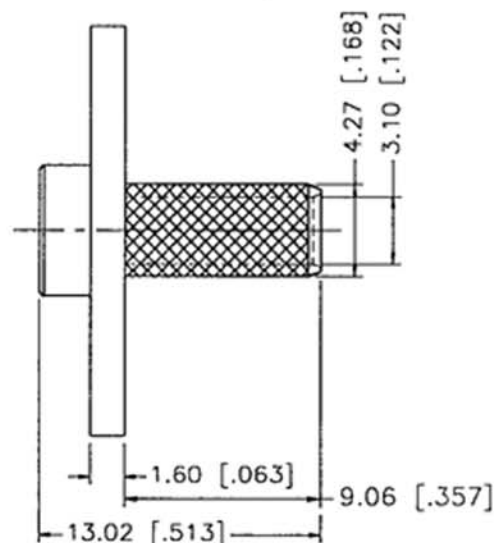

RECOMMENDED
CABLE STRIPPING DIMS.

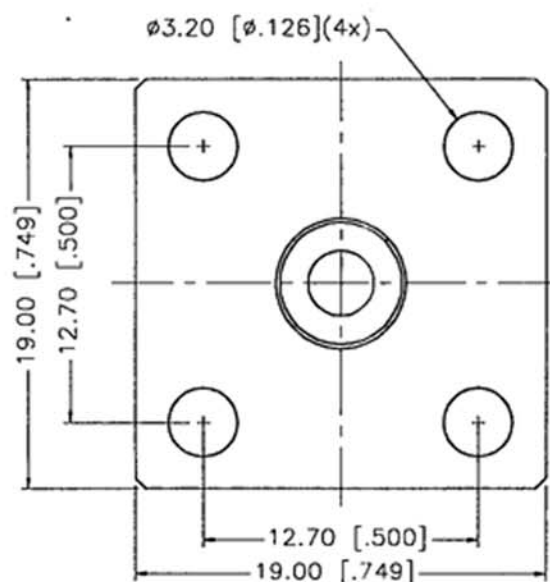

8				UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN MILLIMETERS	APPROVALS	DATE					
7				DIMENSIONS IN [] ARE IN INCHES FOR CUSTOMER REFERENCE ONLY	DRAWN	G.R.S.	12/19/99	Connector Corporation			
6					CHECKED						
5				UNLESS OTHERWISE SPECIFIED TOLERANCES FOR MILLIMETERS ARE: 0.5-6 = ± 0.2 6-30 = ± 0.4 30-120 = ± 0.6 120-315 = ± 1 315-1000 = ± 1.6 1000-2000 = ± 2.4	ISSUED		TITLE 4 HOLE FLANGE MOUNT TERMINATION (FOR RG-223/142/400 CABLE)				
4								SIZE A	1SCM NO. 99001	DWG. NO. 142278.DWG	REV. NC
3	FERRULE	BRASS	NICKEL								
2	FLANGE	BRASS	NICKEL								
1	BODY	BRASS	NICKEL								
	DESCRIPTION	MATERIAL	FINISH	DO NOT SCALE DRAWING			SCALE NA	PART NO. 142278	SHEET 1 OF 1		