SAFETY ORGANIZATIONS

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROYED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

UL RECOGNIZED: UL 1283 CSA CERTIFIED: CSA 22.2, # 8 VDE APPROVED: EN 133200

OPERATING SPECIFICATIONS

LINE CURRENT/YOLTAGE: 1 AMP/40°C, 120/250YAC

LINE FREQUENCY: 50-60Hz

MAXIMUM LEAKAGE CURRENT,

COMMON

dΒ

DIFF

dΒ

30 40 48 50

16

52 52

50

0.40mA @ 120V, 60Hz EACH LINE TO GROUND: 0.70mA@ 250V, 50Hz

OPERATING AMBIENT TEMP. RANGE: -10°C TO +40°C @ RATED CURRENT, Ic.

IN AN AMBIENT, T_0 , HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT, I_0 , IS AS FOLLOWS: $I_0 = I_0 - \sqrt{100 - I_0}$ $I_0 = I_r - /$

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE: -40°C TO +85°C HUMIDITY: 21 DAYS @ 40°C 95% RH. CURRENT DYERLOAD TEST: 6 TIMES In FOR 8 ZECONOS

TEST SPECIFICATIONS:

INDUCTANCE: 1.86mH NOMINAL

CAPACITANCE: (MEASURED @ 1KHz, 0.250YAC MAX., 25°C±1°C)

LINE TO GROUND: 0.0089µF ±20% LINE TO LINE: 0.012uF ±20% DISCHARGE RESISTOR: 1.5M

L/G AND L/L I.R. NO DISCHARGE RESISTOR:

6000M₂ (MIN.) @ 100VDC, 20°C AND 50% RH

CATALOG # 1VB1

CUSTOMER DRAWING 1VB1

1VB1

REY.

B

SCALE: NTS DATE: 12SEP89 CATALOG NO.

ORIG: CW

ECO # APPRVD DATE


|30N0V06

RECOMMENDED RECEIVING INSPECTION HIPOT:

LINE TO GROUND: 1500YAC OR 2250YDC FOR 1 MINUTE LINE TO LINE: 1450YDC FOR 1 MINUTE

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

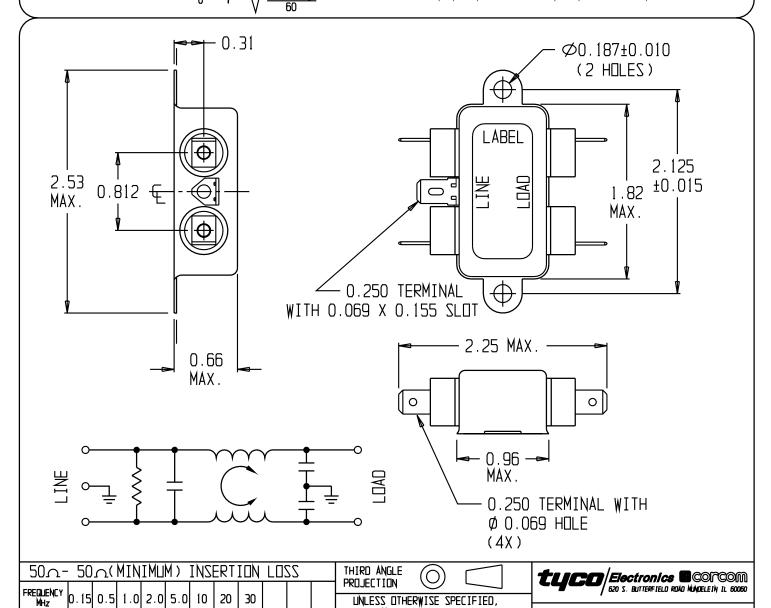

TOLERANCE TO BE ±.025

MATERIAL & FINISH: AS SUPPLIED

and is not to be reproduced nor used for

monufacturing purposes except on CORCOM'S prior written consent.

This document is proprietory to CORCOM INC. TYCO: 0-6609021-1